


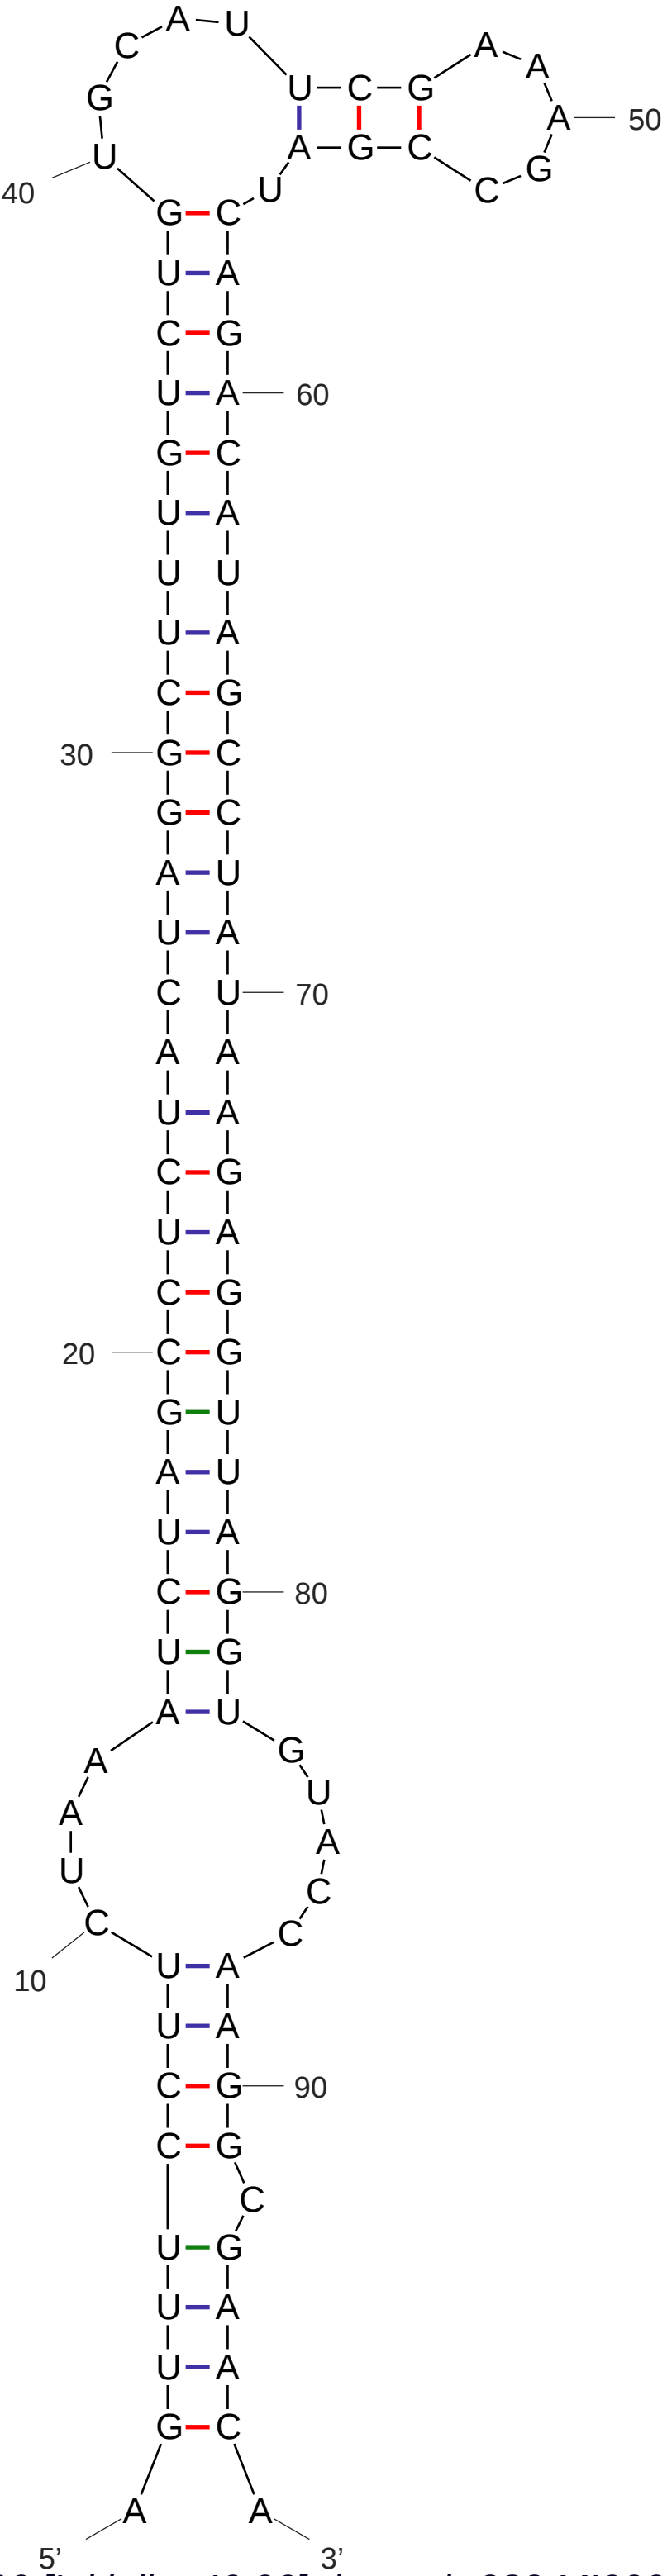

$dG = -40.90$ [Initially -40.90] dme-mir-282 MI0000367