


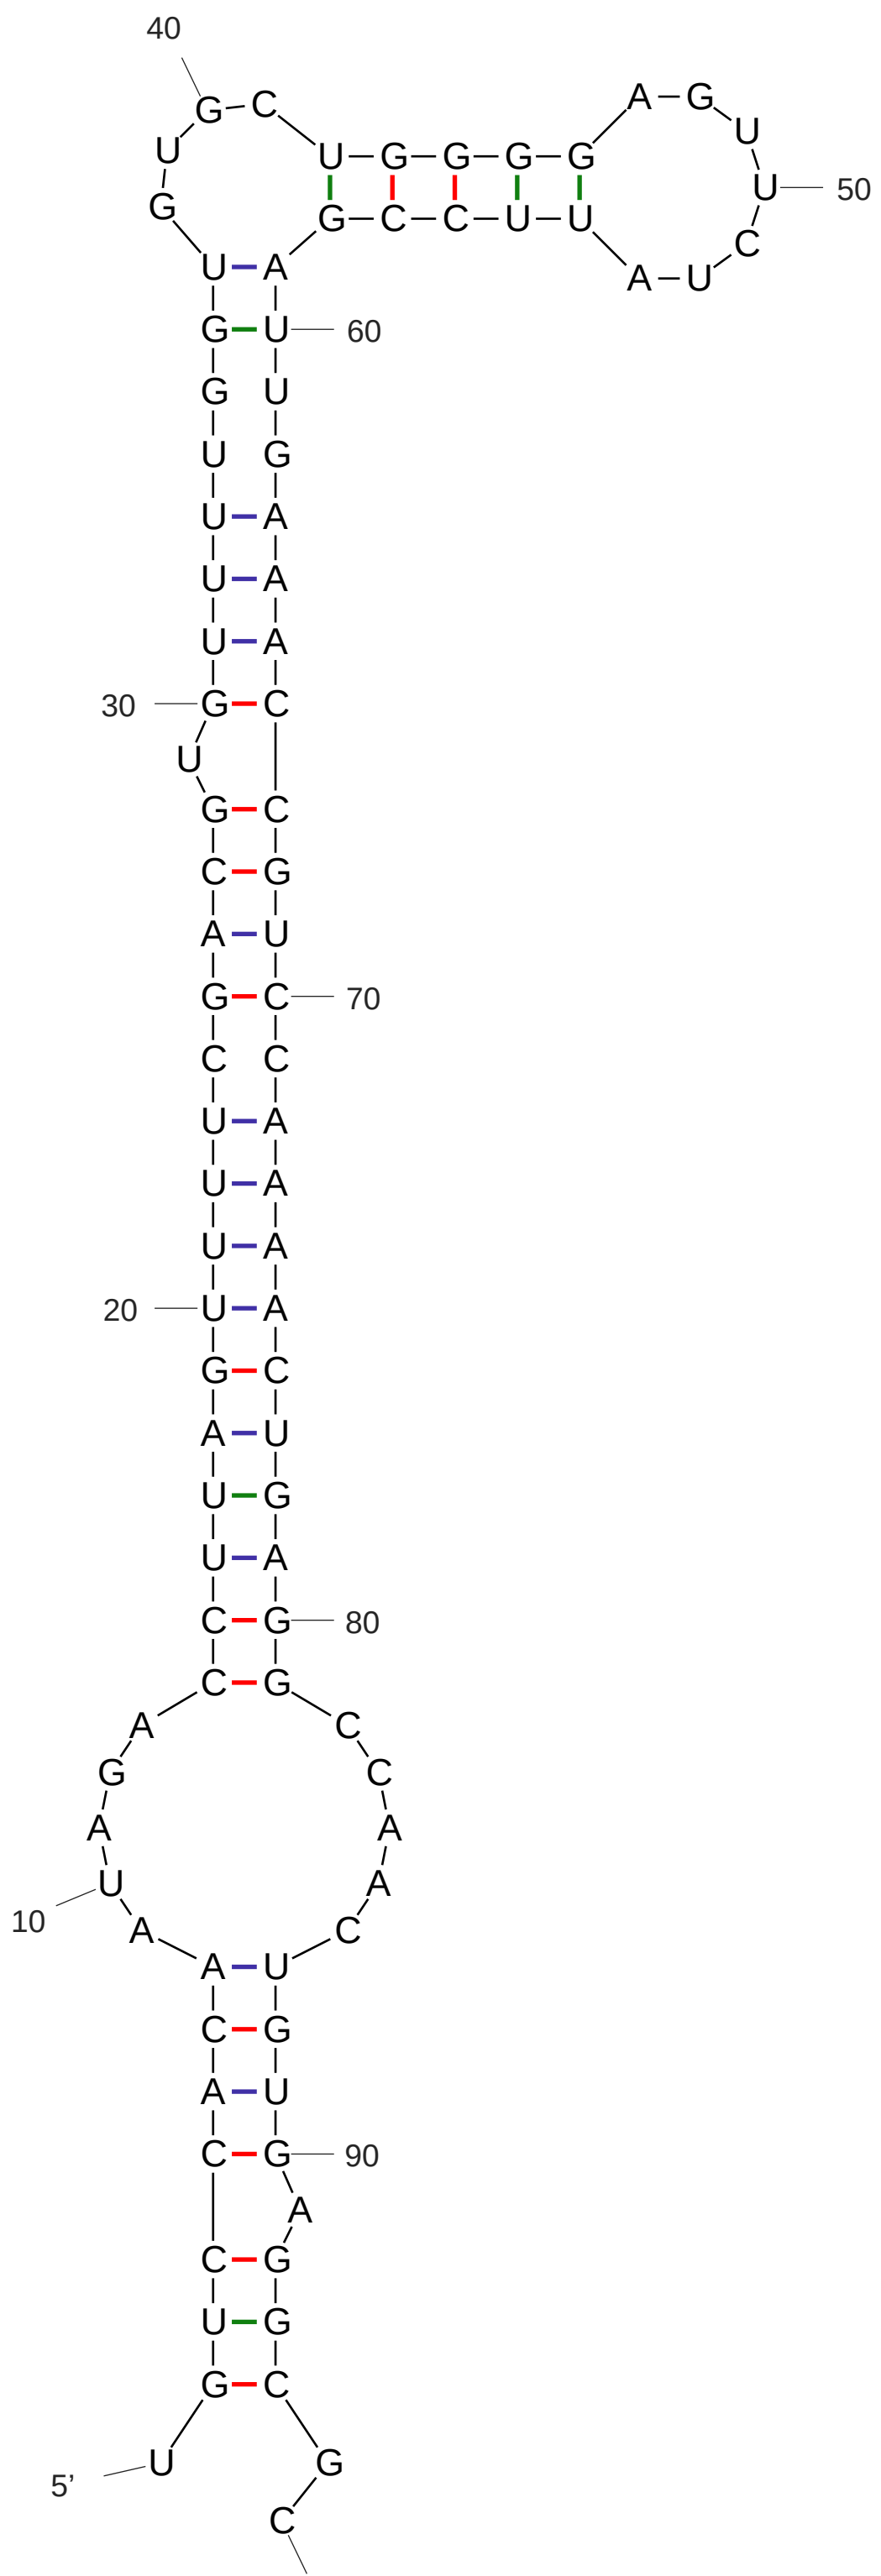

*dG = -35.00 [Initially -35.00] dme-mir-957 MI0005811*